



Elforlaget







WEBER

35 A 500 V

CE


02/99

D

2P

**KEMA
EUR**

UL

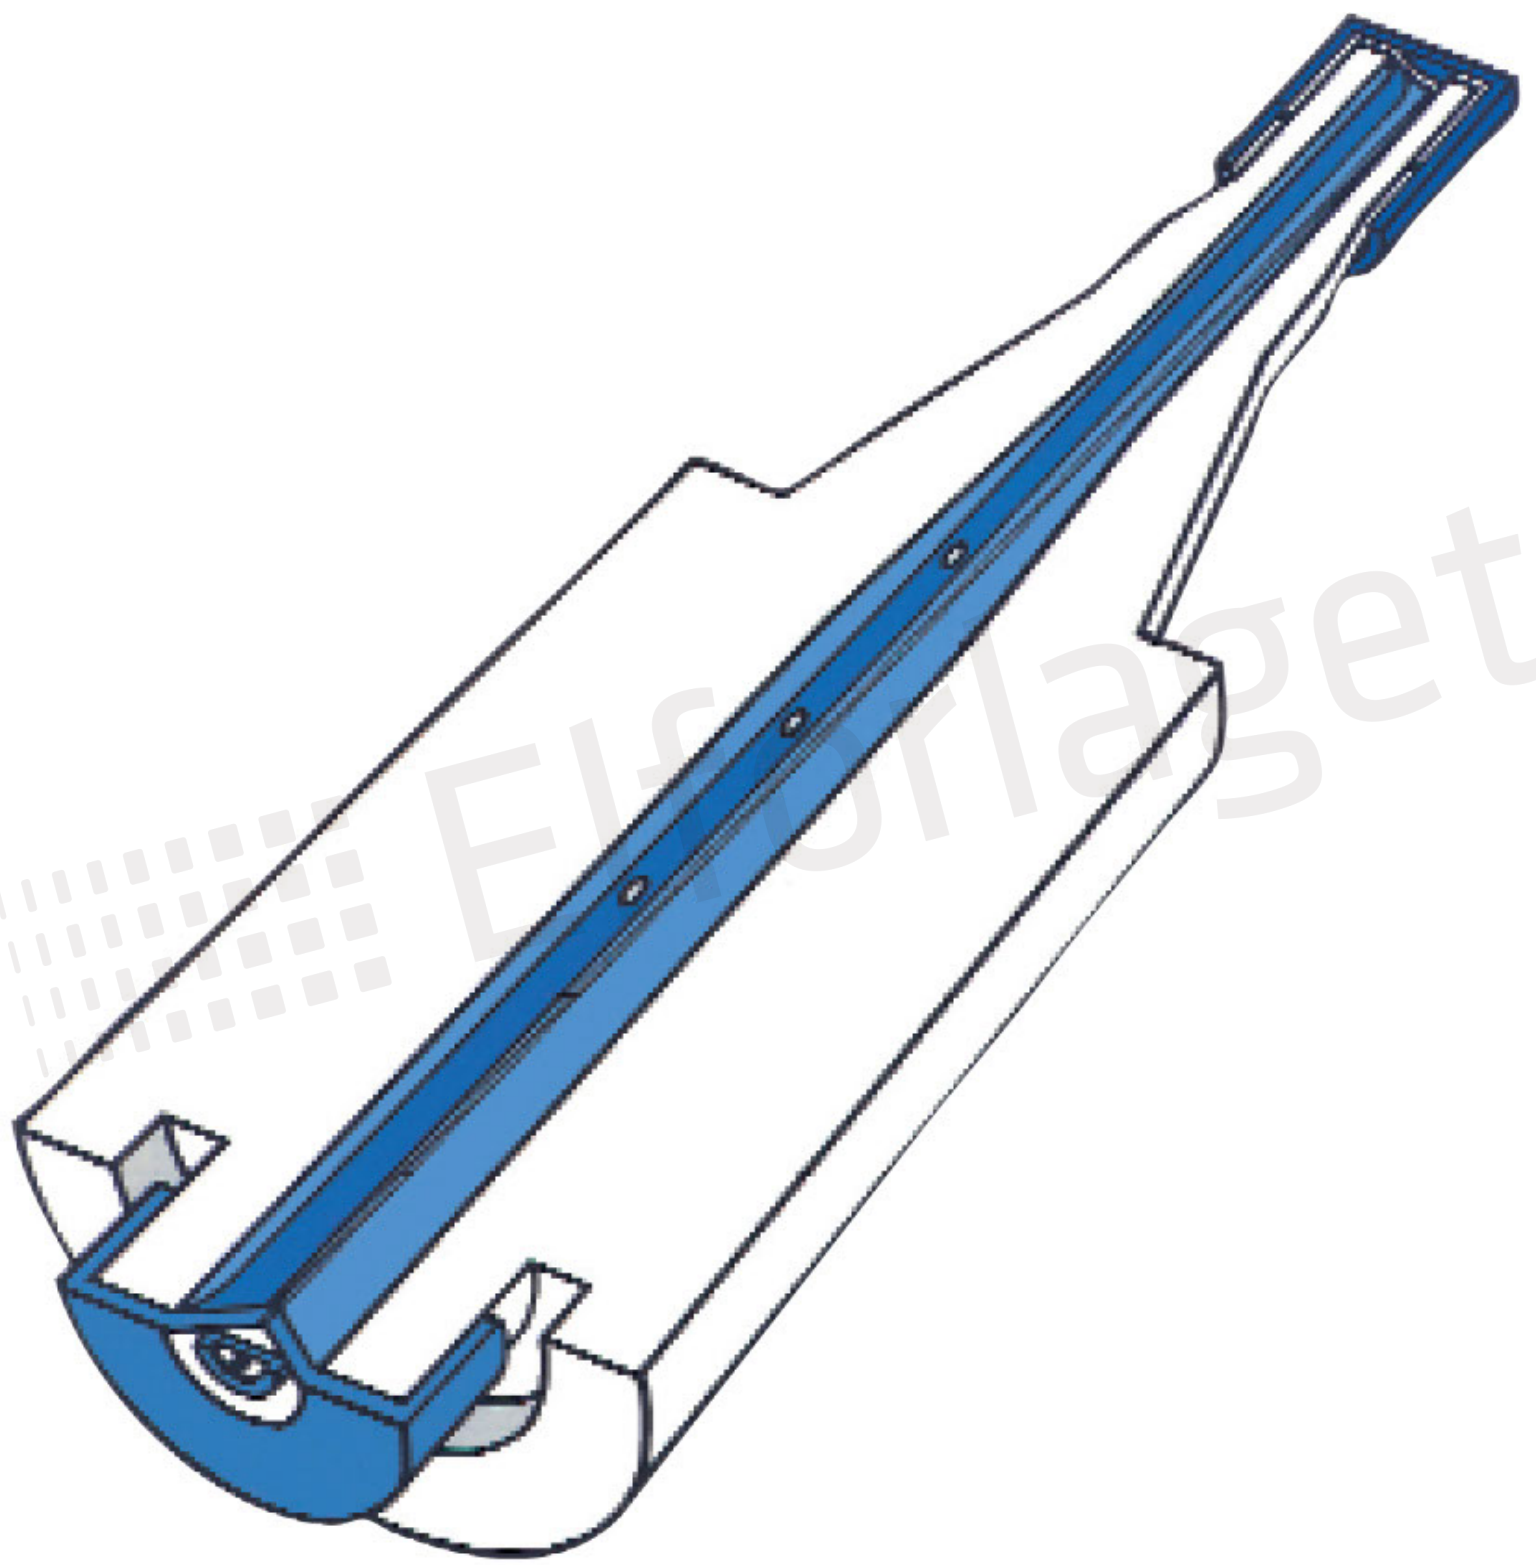



NH000 gL/gG
100A

500V

120kA
korrosionsfest
Cd/Pb-free

CE

forlaget





JP79A

1


3

$I_{\Delta n} = 0,03A$
C16



-230V

10000
3



RCBO



Xpole
PKPM2 - 16/2/C/003-A

2

4


Fabrikat

Testknapp

Høyeste strøm
vernet tåler

Type

Merkestrøm (I_n) 16 A, Topolt, C-automat

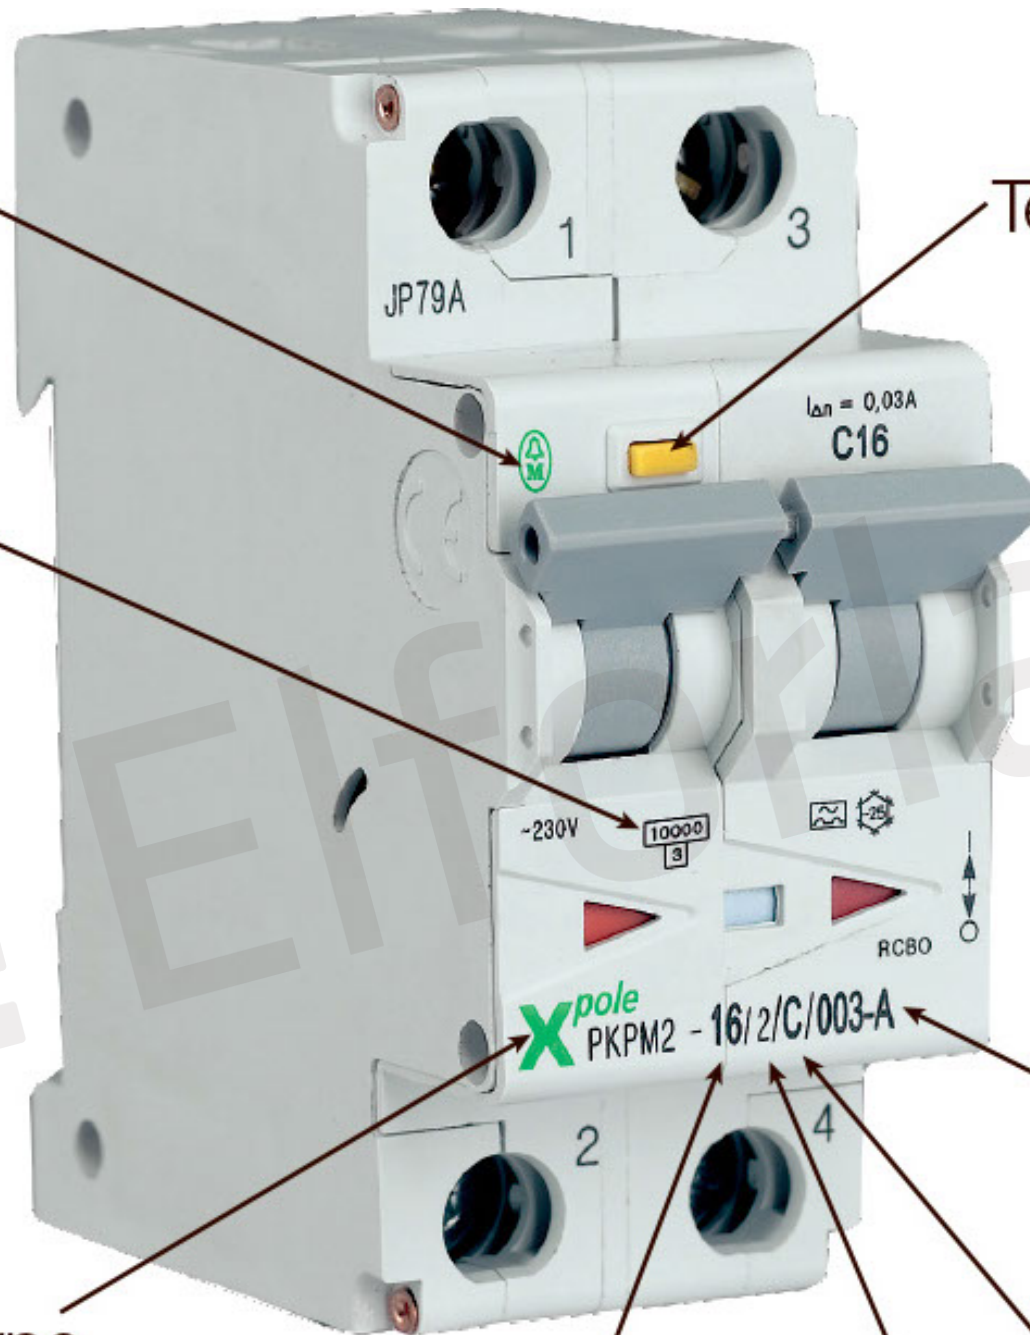

Jordfeilbryterens
merkestrøm
30 mA




MOELLER 

MOELLER 

MOELLER 


 II  T2


 $I_n = 160A_{gI}$
 $I_{max} = 20kA$
 $U_c = 280VAC$
 $U_p = 1400V$

CE

Xplus
SPC-S-20/280


 II  T2


 $I_n = 160A_{gI}$
 $I_{max} = 20kA$
 $U_c = 280VAC$
 $U_p = 1400V$

CE

Xplus
SPC-S-20/280

 II  T2


 $I_n = 160A_{gI}$
 $I_{max} = 20kA$
 $U_c = 280VAC$
 $U_p = 1400V$

CE

Xplus
SPC-S-20/280



MOELLER 

ELSTER


A1100



Made in UK

049094

Målerstand kWh _____ L1 L2 L3
Reverse indikator



LB2BBCBS-A

2006

3 x 230V
2 x 5 (85)A 50 Hz

500 imp/kWh

N-10/2004, 1. tillegg
Miljøklasse 1 og 2
-40°C til +55°C

Class 2.0 EN50336-1998
∩ = 5 Wh/PULSE



Tlf. 03101

021911

